PACKAGED UNITS KITS AND ACCESSORIES

506218-02 4/2022 Supersedes 7/2022

D4P120 & D4S SMOKE DETECTOR KITS

INSTALLATION INSTRUCTIONS FOR SMOKE DETECTOR KITS USED WITH KC/KG/KH024-090 & LG/LC/LH/LD 024-074 UNITS

Shipping and Packing List

21Z11; 603408-11

Single-sensor kit contains the following:

- 1- Smoke detector sensor
- 1- Smoke detector power board
- 1- Supply bracket
- 1- Supply brace
- 1- Return bracket (used on KC, KG & KH units only)
- 1- Return brace (used on KC, KG & KH units only)
- 1- Power harness
- 1- Supply or return air harness
- 1- Jumper harness
- 1- Metal sampling tube
- 1- Plastic exhaust tube
- 1- Magnet
- 1- Sensor manufacturer's instructions
 - #10 16 X 3/4" sheet metal screws
 - #8 32 X 1" thread-forming screws

21Z12; 603408-12

Dual-sensor kit contains the following:

- 2 Smoke detector sensors
- 1 Smoke detector power board
- 1 Supply bracket
- 1 Supply brace
- 1 Return bracket (used on KC, KG & KH units only)
- 1 Return brace (used on KC, KG & KH units only)
- 1 Power harness
- 1 Supply and return air harness
- 2 Metal sampling tubes
- 2 Plastic exhaust tubes
- 2 Magnets
- 1 Sensor manufacturer's instructions
 #10 16 X 3/4" sheet metal screws
 #8 32 X 1" thread-forming screws

Application

LG, LC, LH, and LD Units -- Smoke detector will send a 24Vac signal to the unit controller when smoke is sensed. Unit controller default mode will de-energize unit.

KC, KG and KH Units -- Smoke detector will interrupt the 24Vac signal to the unit control circuit when smoke is sensed. Unit will be de-energized.

Identify Harnesses

Three harnesses are provided in the single sensor kit and two harnesses are provided in the dual sensor kit. Use wire labels, length of harnesses and number and size of connectors to determine appropriate harnesses used in each application. Refer to FIGURE 1 for 53W78 single sensor kits and FIGURE 2 for 54W79 dual sensor kits.

Installation

Turn the electrical power to unit OFF at disconnect switch.

Improper installation, adjustment, alteration, service or maintenance can cause property damage, person al injury or loss of life. Installation and service must be performed by a licensed professional installer (or equivalent), service agency or the gas supplier.

- To prevent serious injury or death:
- 1. Lock-out/tag-out before performing maintenance.
- 2. If system power is required (e.g., smoke detector maintenance), disable power to blower, remove fan belt where applicable, and ensure all controllers and thermostats are set to the "OFF" position before performing maintenance.
- 3. Always keep hands, hair, clothing, jewelry, tools, etc., away from moving parts.

As with any mechanical equipment, contact with sharp sheet metal edges can result in personal in jury. Take care while handling this equipment and wear gloves and protective clothing.



HARNESS IDENTIFICATION (not to scale) 53W78 SINGLE SENSOR KITS (SUPPLY AIR ONLY <u>OR</u> RETURN AIR ONLY APPLICATIONS)	
POWER HARNESS - 2 FT. IN LENGTH Used in KG/KC/KH applications. Discard in LG/LC/LH/LD applications. 95	ARNESS - 4" IN LENGTH I/LD supply air only applications. ness in other applications. PIN 4-PIN 01-1 01-2 01-2 01-3 01-4 01-5 01-6 004374
SUPPLY OR RETURN AIR HARNESS - APPROX. 10 FT. IN LENGTH Use this harness in unit return air only AND KG/KC/KH supply air only applications. Discard in LG/LC/LH/LD applications; harness is provided in unit. 4-PIN P251-1 P251-2 P251-3 P251-4 604650	
FIGURE 1	
HARNESS IDENTIFICATION (not to scale) 53W79 DUAL SENSOR KITS (COMBINATION SUPPLY AIR <u>AND RETURN AIR APPLICATIONS)</u>	
POWER HARNESS - 2 FT. IN LENGTH Used in all KG/KC/KH unit applications. Discard in all LG/LC/LH/LD unit applications. 95	604651
SUPPLY AND RETURN AIR HARNESS - 4 CONNECTORS Used in all dual sensor applications. 4-PIN P251-1 P250-1 P250-1	
P251-2 P251-3 P251-4	P250-1 P250-2 P250-3 P250-4 6-PIN
P253-1 P253-2 P253-3 P253-4	01110 0252-1 0252-2 603526 0252-3 0252-4 0252-5 0252-6
FIGURE 2	




Installation - continued

Smoke detector sensor and power board installation


Use manufacturer's instructions provided with smoke detector to install sensor(s) and power board. Refer to FIGURE 3 for location of power board, supply air sensor and return air sensor on units with an economizer. For location of return air sensor on units without an economizer, refer to FIGURE 4 for KC, KG and KH units, and FIGURE 5 for LG, LC, LH, and LD units.

Sampling tube installation

- Slide metal sampling tube onto the back side of the sensor as shown in FIGURE 6. When sensor is installed in return air applications, slide plastic exhaust tube onto back side of the sensor as shown in FIG-URE 6. NOTE - Plastic exhaust tube is NOT used in supply air applications and should be discarded.
- 2 Orient sampling tube so that holes point toward the air stream.

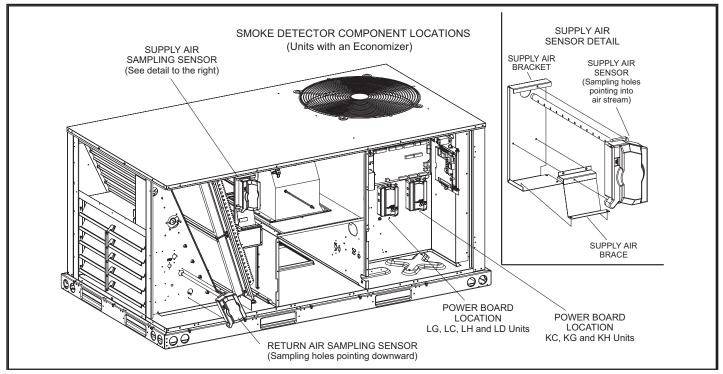



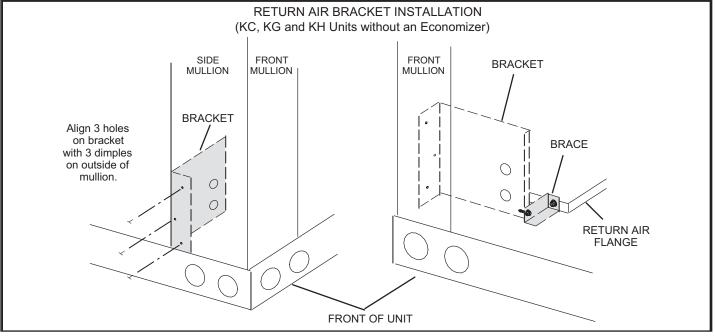



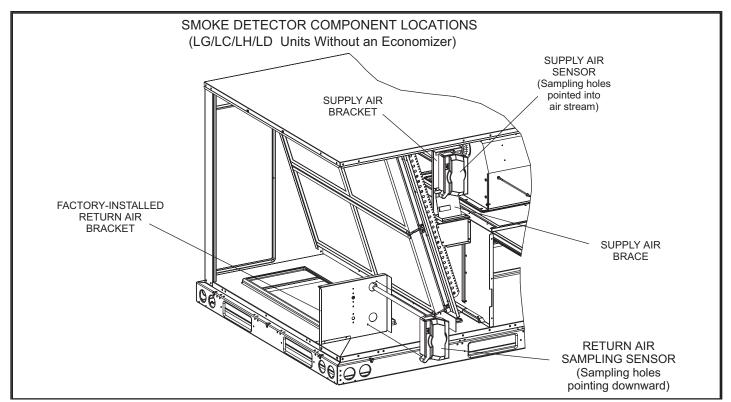


FIGURE 5

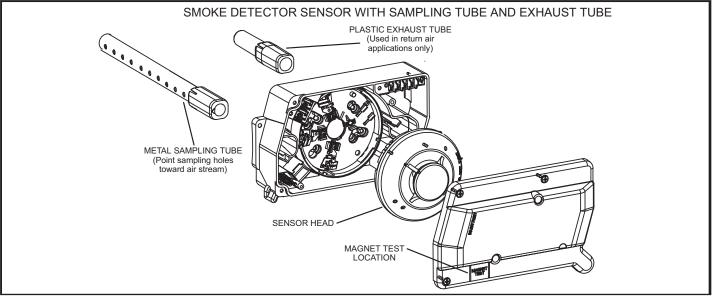


FIGURE 6

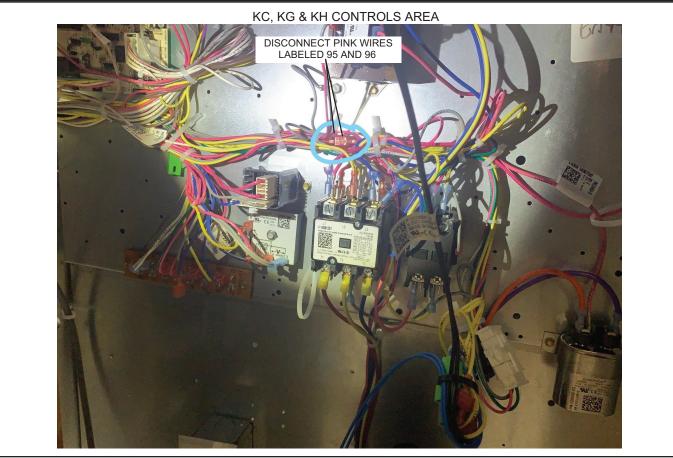


FIGURE 7

Wiring - KG/KC/KH Units

- Locate and disconnect pink wires labeled 95 and 96 in the control area above compressor. See FIGURE 7.
- 2 Connect wires labeled 95, 96 and TB1-C from the kit harness to wires labeled 95, 96 and TB1-C in unit.
- 3 Route harness wires to the top of the unit. Secure to existing bundle of wires and route to control area above compressor. See FIGURE 8. Make sure wires are secured away from other components.
- 4 Make jack/plug connections as shown in FIGURE 9 when installing return air smoke detector only, FIG-URE 10 when installing supply air smoke detector only, and FIGURE 11 when installing both supply and return air smoke detectors. Refer to respective wiring diagrams in FIGURE 12, FIGURE 13, and FIGURE 14.

NOTE - In single-sensor applications, the wiring harness is sized for return air applications. There will be excess wiring in supply air applications. Gather excess wire and secure away from other components.

WIRE ROUTING KG, KC & KH UNITS

Connect J255 and P250 harnesses to power board P255 and J250. On dual sensor applications, also connect P252 harness to power board J252.



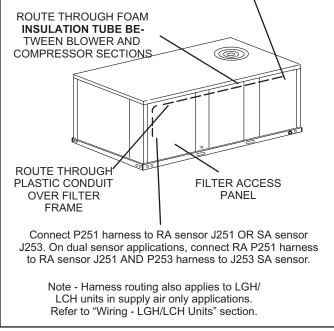


FIGURE 8





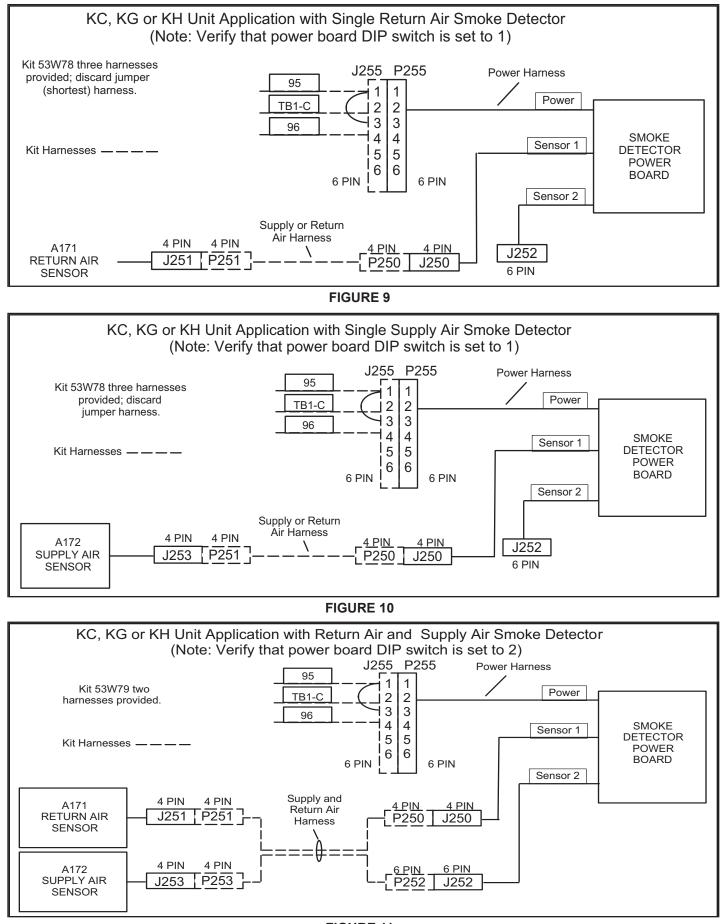

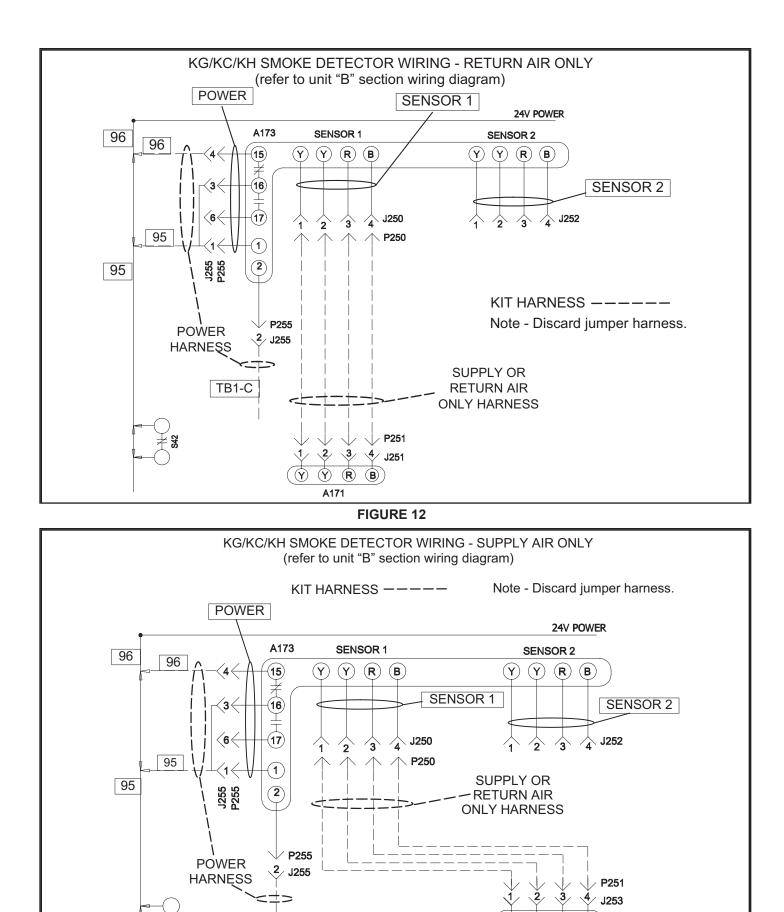

S42

TB1-C

 $(\mathbf{Y} \ \mathbf{R})$

A172

Y)

B


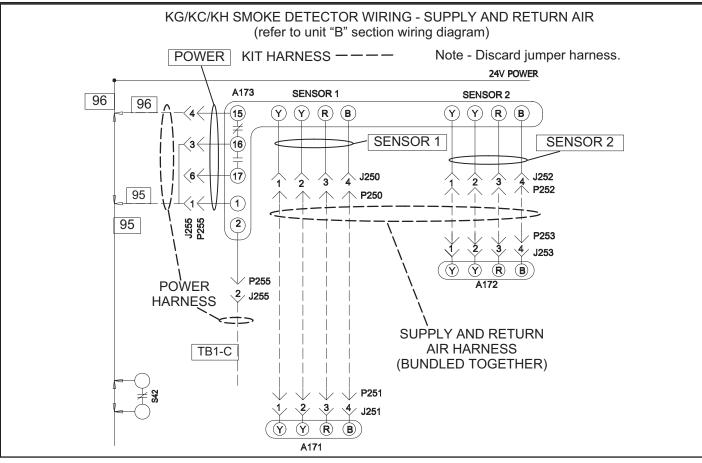



FIGURE 14


Wiring - LGH & LCH Units

Make jack/plug connections as shown in FIGURE 15 when installing return air smoke detector only, FIGURE 16 when installing supply air smoke detector only and FIGURE 17 when installing both supply and return air smoke detectors. Refer to wiring diagrams in FIGURE 18, FIGURE 19, and FIGURE 20.

The kit jumper harness is used in single supply air applications only. Route harness as shown in FIGURE 8. Discard harnesses in other applications.

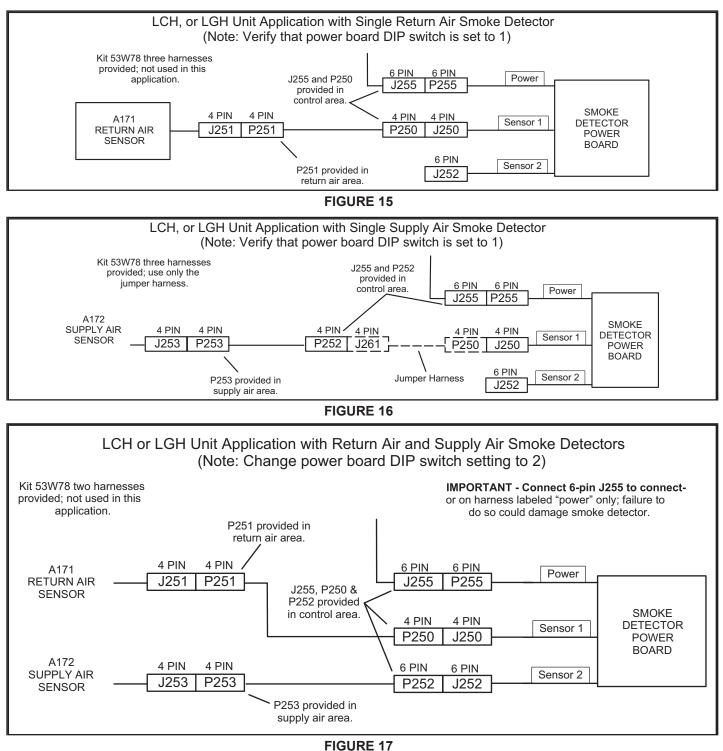

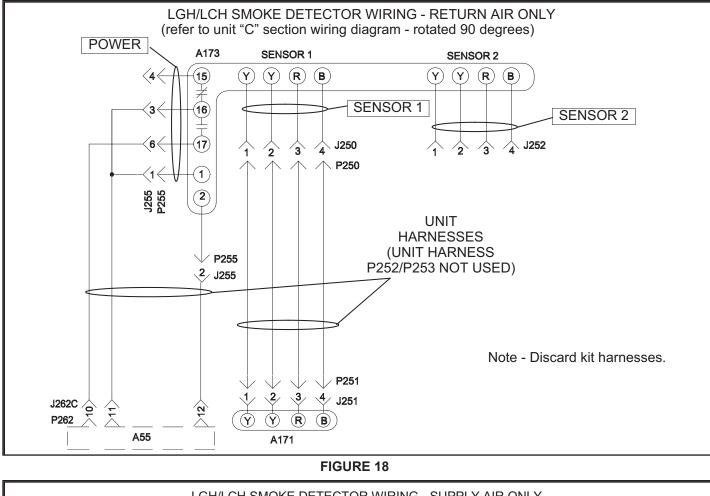

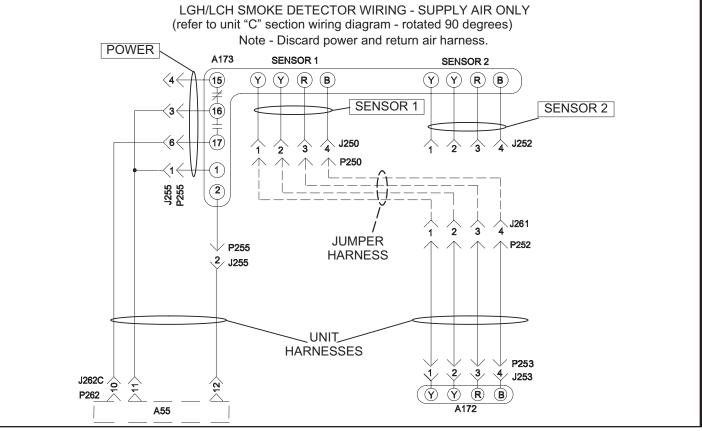



Page 10

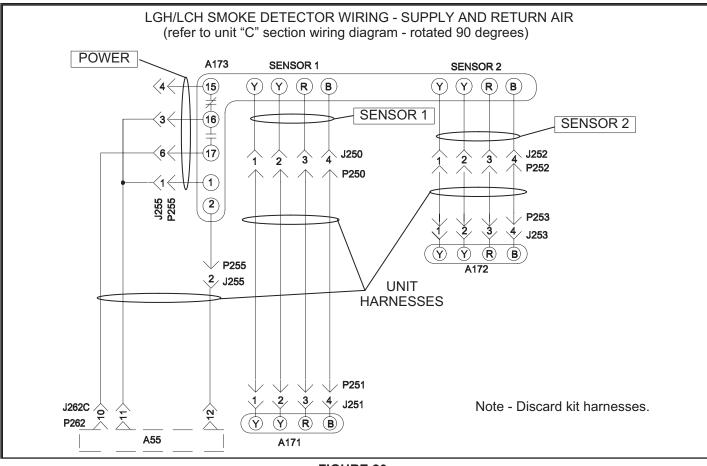


FIGURE 20

Wiring - LGM, LCM, LGT, LCT, LHT, LDT, LHX, LCX, LGX

Make jack/plug connections as shown in FIGURE 21 when installing return air smoke detector only, FIGURE 22 when installing supply air smoke detector only and FIGURE 23 when installing both supply and return air smoke detectors. Refer to wiring diagrams in FIGURE 24.

The kit jumper harness is used in single supply air applications only. Route harness as shown in FIGURE 8. Discard harnesses in other applications.

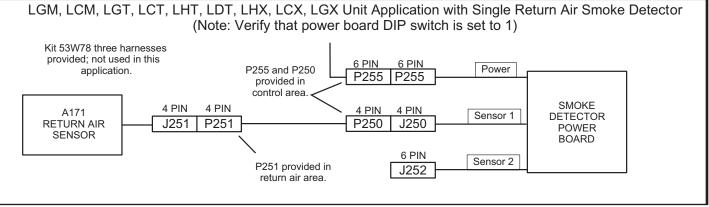


FIGURE 21



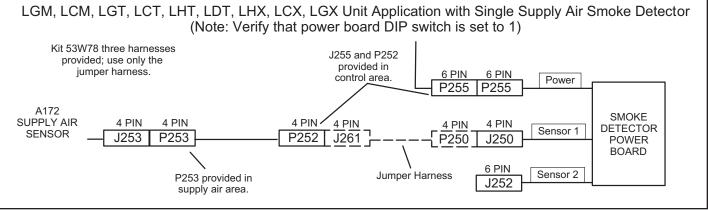


FIGURE 22





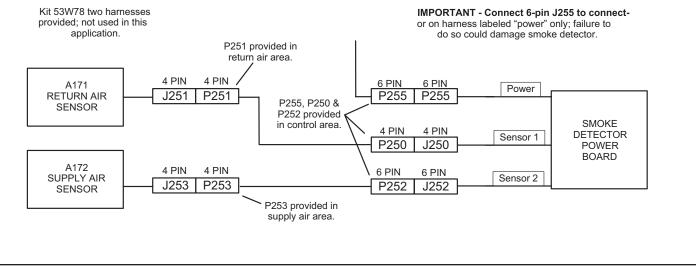

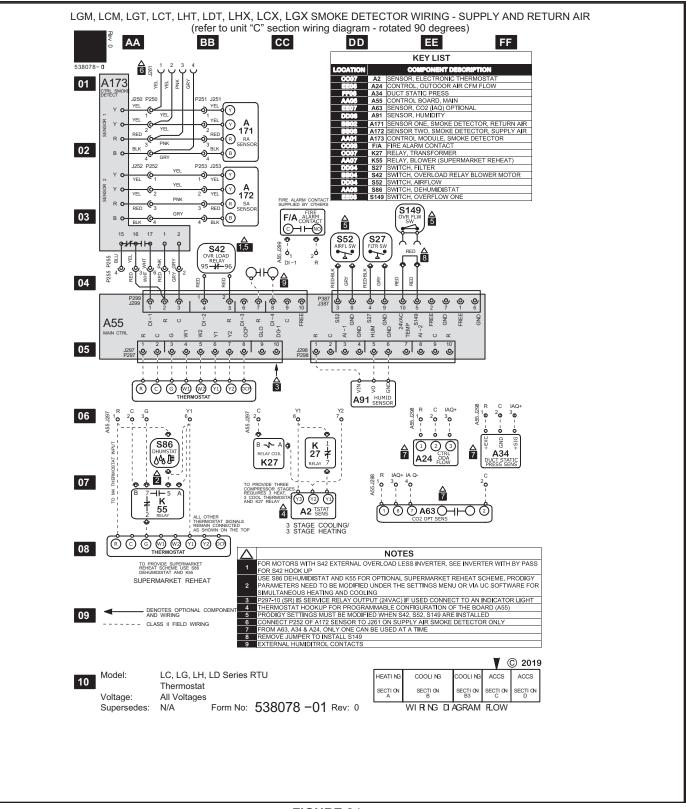

Test Magnet(s)

A test magnet is provided in a bag assembly with each sensor. Remove the magnet from the bag assembly and place it on a metal surface near the sensor. The magnet is used during test procedures.

Maintenance and Test Procedure Instructions

The sensor manufacturer's instructions, which are provided with each sensor, outline information on maintenance and test procedures. Place these instructions in the literature pouch for future reference.

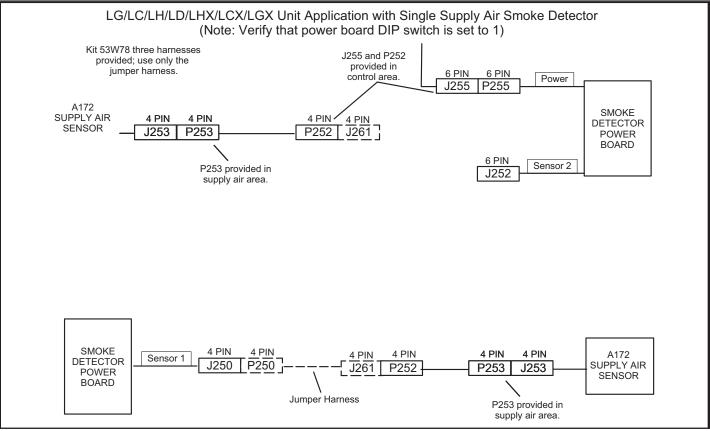


FIGURE 25